


5 4 3 2



- NOTES:**
1. FOR PLAN SYMBOLS SEE DWG WA-E-002
 2. WIRING FOR FIRE DETECTION SHALL BE CLASS 'A', FOR FIRE ALARM DEVICES SHALL BE CLASS 'B'.
 3. DUCT MOUNTED SMOKE DETECTORS SHALL BE PROVIDED WITH AN AUXILIARY RELAY CONTACT (N.C.) FOR EQUIPMENT "SHUT-DOWN".
 4. COORDINATE SMOKE DETECTOR LOCATIONS WITH CLEAN AGENT DISCHARGE NOZZLES.
 5. COORDINATE ARM LOCATIONS AND DUCT MOUNTED SMOKE DETECTORS.



MATCHLINE SEE DWG WA-E-110

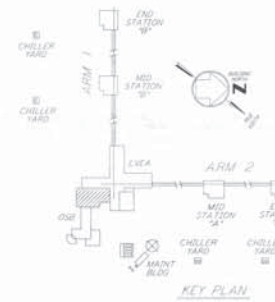

This document and the design it covers are the property of PARSONS. They are loaned only with the borrower's expressed written agreement that they will not be reproduced, copied, issued, exhibited, or used in any way without the express written consent of PARSONS.

NO.	DATE	BY	CHKD	ENGR	PROJ	DESCRIPTION

ALL ISSUES FOR CONSTRUCTION
DRAWN: AL, BK F-25-26
CHECKED: SW F-3, F2
ENGINEER: [Signature] 5/3/08
PROJ: [Signature] 7/1/08



LASER INTERFEROMETER
 GRAVITATIONAL-WAVE OBSERVATORY
 SITE NO. 1 - HANFORD, WASHINGTON
 TITLE: ELECTRICAL CORNER STATION OSB LAB AREA FIRE DET & SECURITY PLAN
 AS NOTED PPI 50969 8094
WA-E-111