


- NOTES:**
- FOR LEGEND AND GENERAL NOTES SEE DWG WA-E-005.
 - TRANSFORMERS FEEDING THE CDSAC PANELS ARE TO BE K-13 RATED AND SHALL INCORPORATE AN INTERWINDING SHIELD, GROUNDED TO THE CASE GROUND. TRANSFORMER ARE TO BE SUITABLE FOR OUTDOOR SERVICE.
 - CDSAC PANELS SHALL HAVE 200% RATED NEUTRAL/BUSES.
 - GROUND CONDUCTOR FROM TRANSFORMER NEUTRAL/CASE BOND JUNCTION TO GROUND GRID SHALL BE NO LONGER THAN 4 FT.

**SWITCHBOARD W-CS-107-SB-01
SQUARE D CLASS 2741**

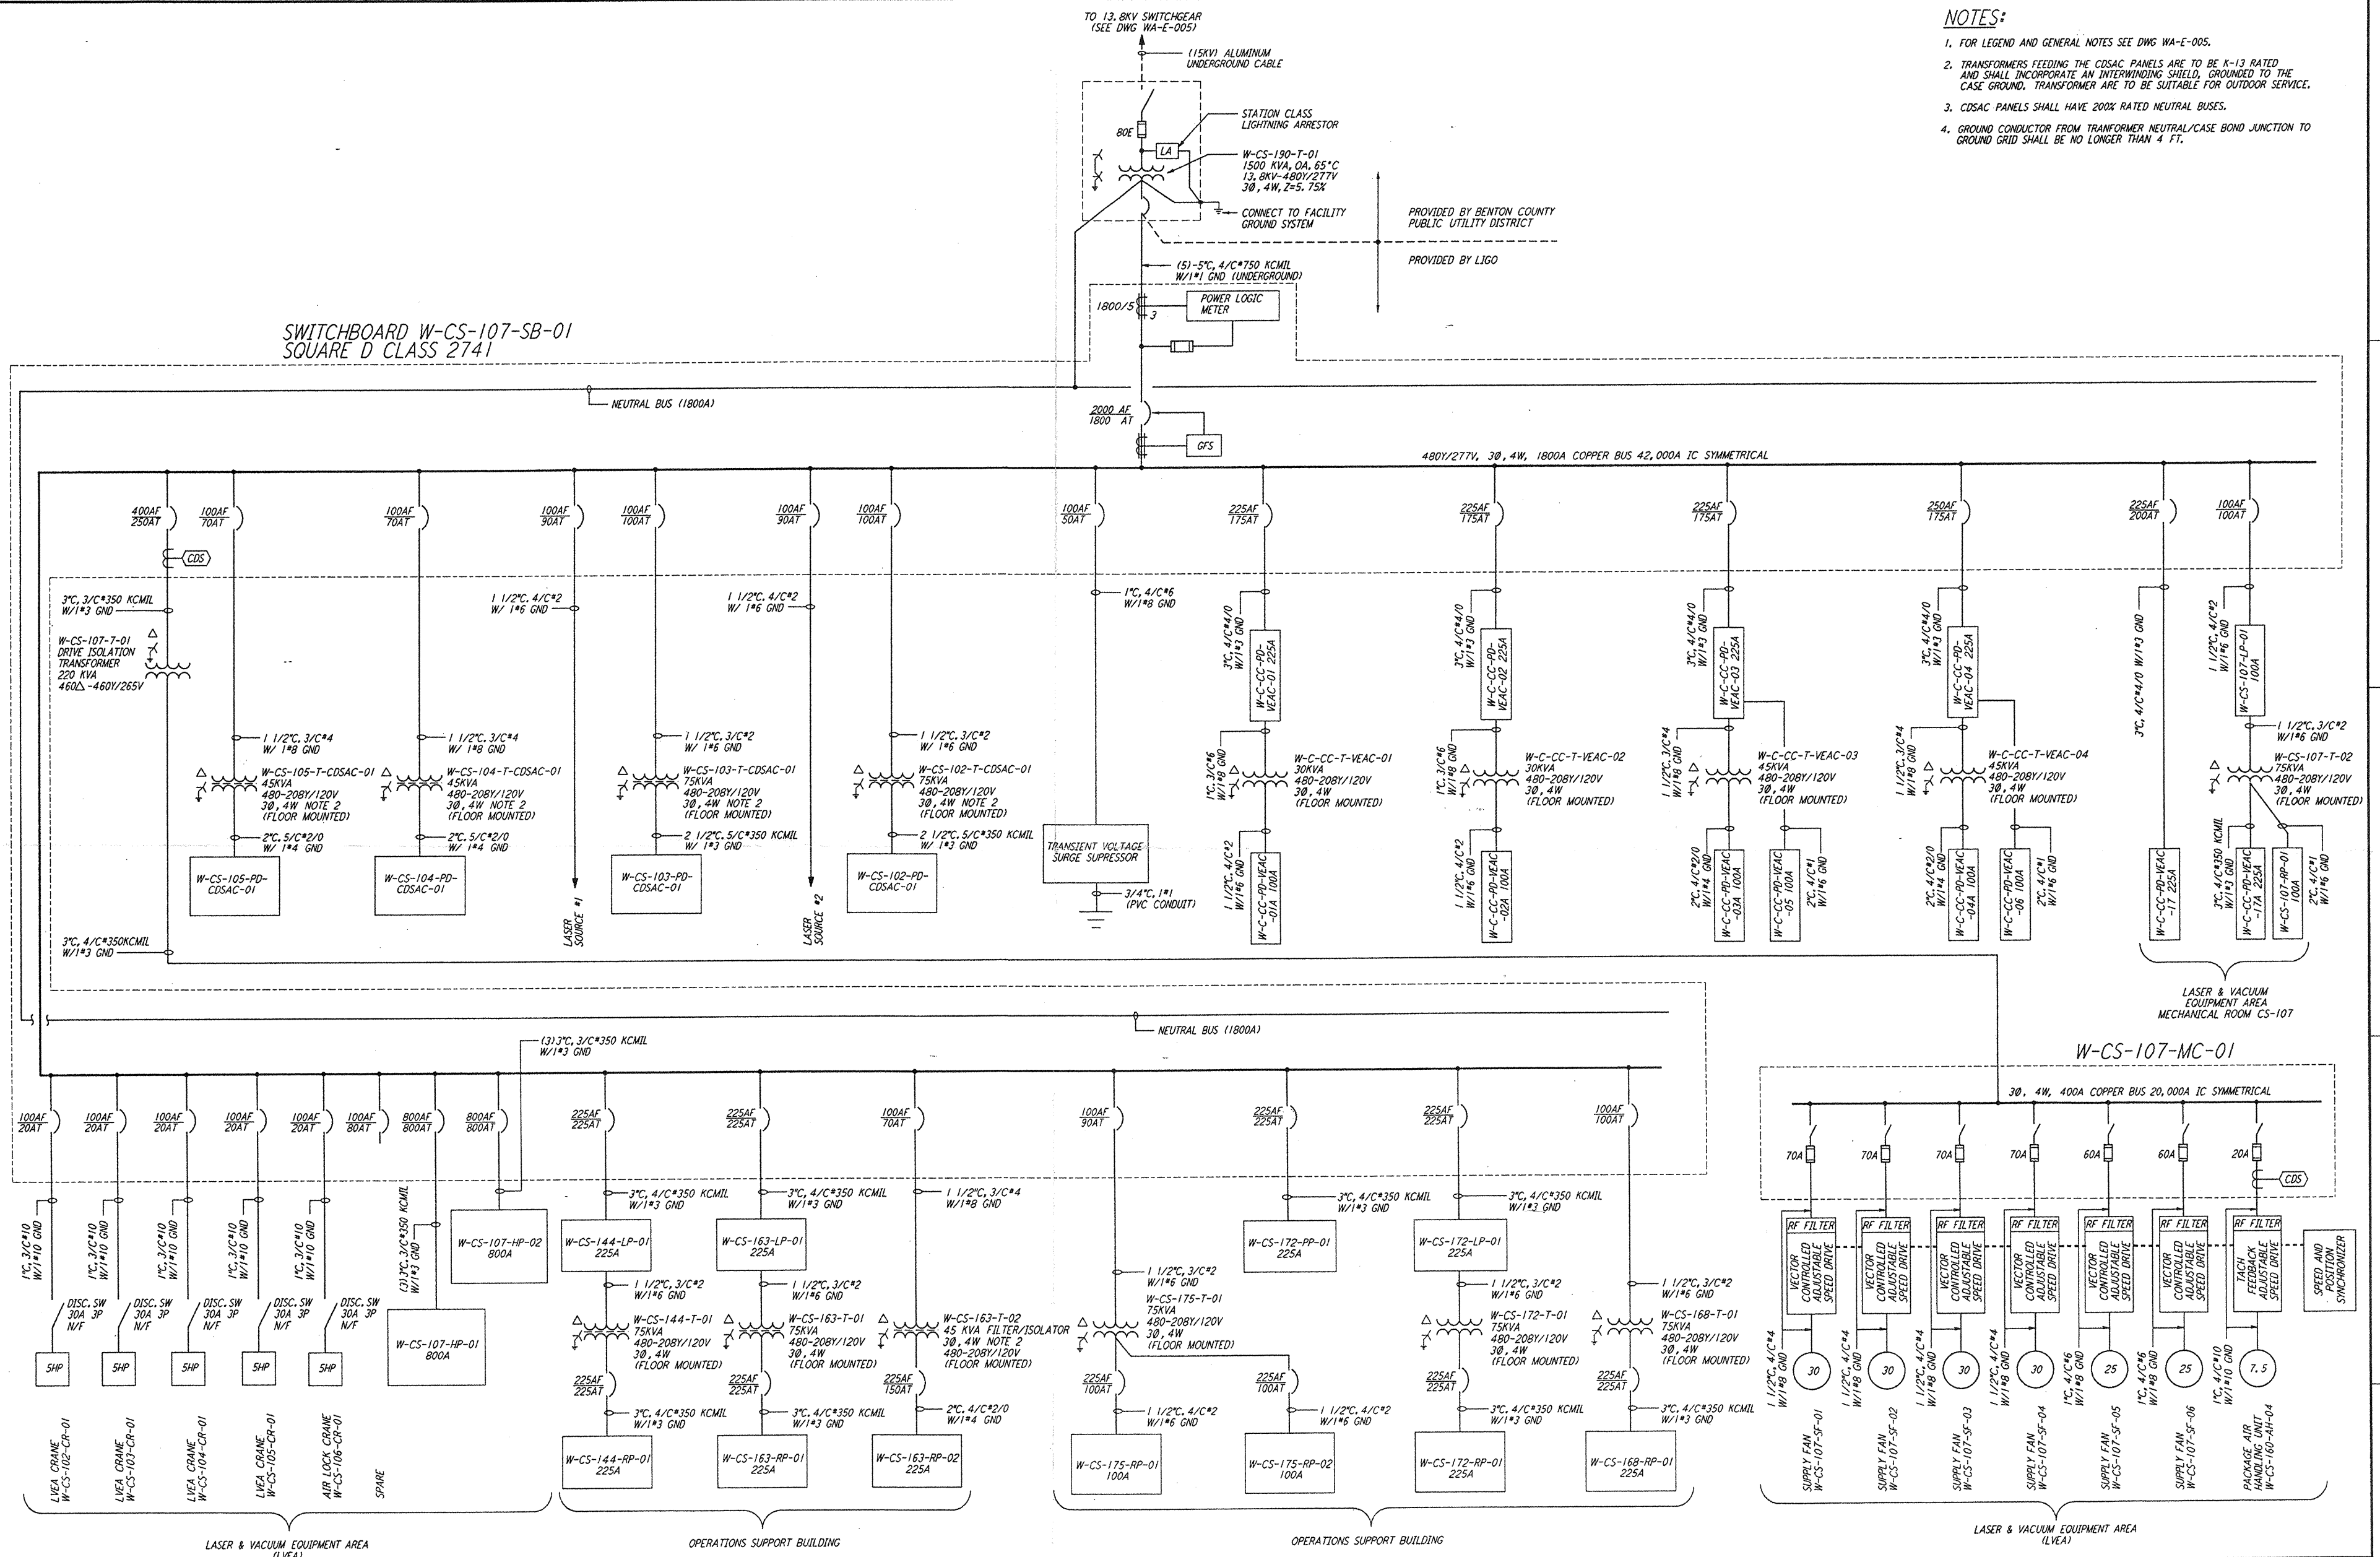

This document and the design it covers are the property of PARSONS. They are loaned only with the borrower's expressed written agreement that they will not be reproduced, copied, loaned, exhibited, or used in any other way, except by written consent from PARSONS to the borrower.

NO.	DATE	BY	CHKD	ENGR	PROJ	DESCRIPTION
B	4-19-96	J.G.	JG	TD	TD	FINAL DESIGN REVIEW
A	10-31-95	J.G.	JG	TD	TD	PRELIMINARY DESIGN REVIEW

DRAWN	J.G.
CHECKED	
ENGINEER	
PROJ	

PARSONS
100 WEST WALNUT STREET
PASADENA, CALIFORNIA

LIGO
CALIFORNIA INSTITUTE OF TECHNOLOGY
MASSACHUSETTS INSTITUTE OF TECHNOLOGY

**LASER INTERFEROMETER
GRAVITATIONAL-WAVE OBSERVATORY
SITE NO. 1 - HANFORD, WASHINGTON**

**ELECTRICAL
CORNER STATION
SINGLE LINE DIAGRAM**

TITLE: NONE
SCALE: NONE
SHEET NUMBER: PP150969
REVISED: 8094

WA-E-006

L130-D960487-B-17 | LIGOWAF.BOR