NOTES:
1.) ALL CABLETRAY LENGTHS ARE 12'-0" UNLESS OTHERWISE SPECIFIED.
2.) ALL CABLE TRAY SHALL BE GROUNDED PER N.E.C.
3.) ALL CABLE TRAY SHALL BE FIELD SUPPORTED.
4.) CABLE TRAY FOR ION PUMP POWER CABLES SHALL BE LABELED "DANGER HIGH VOLTAGE".

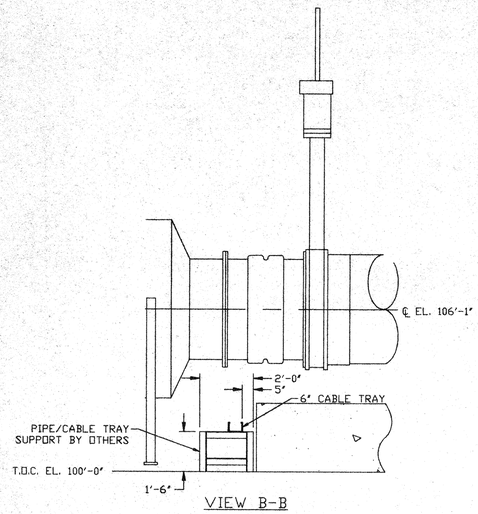

VIEW B-B
SCALE: 3/8" = 1'-0"

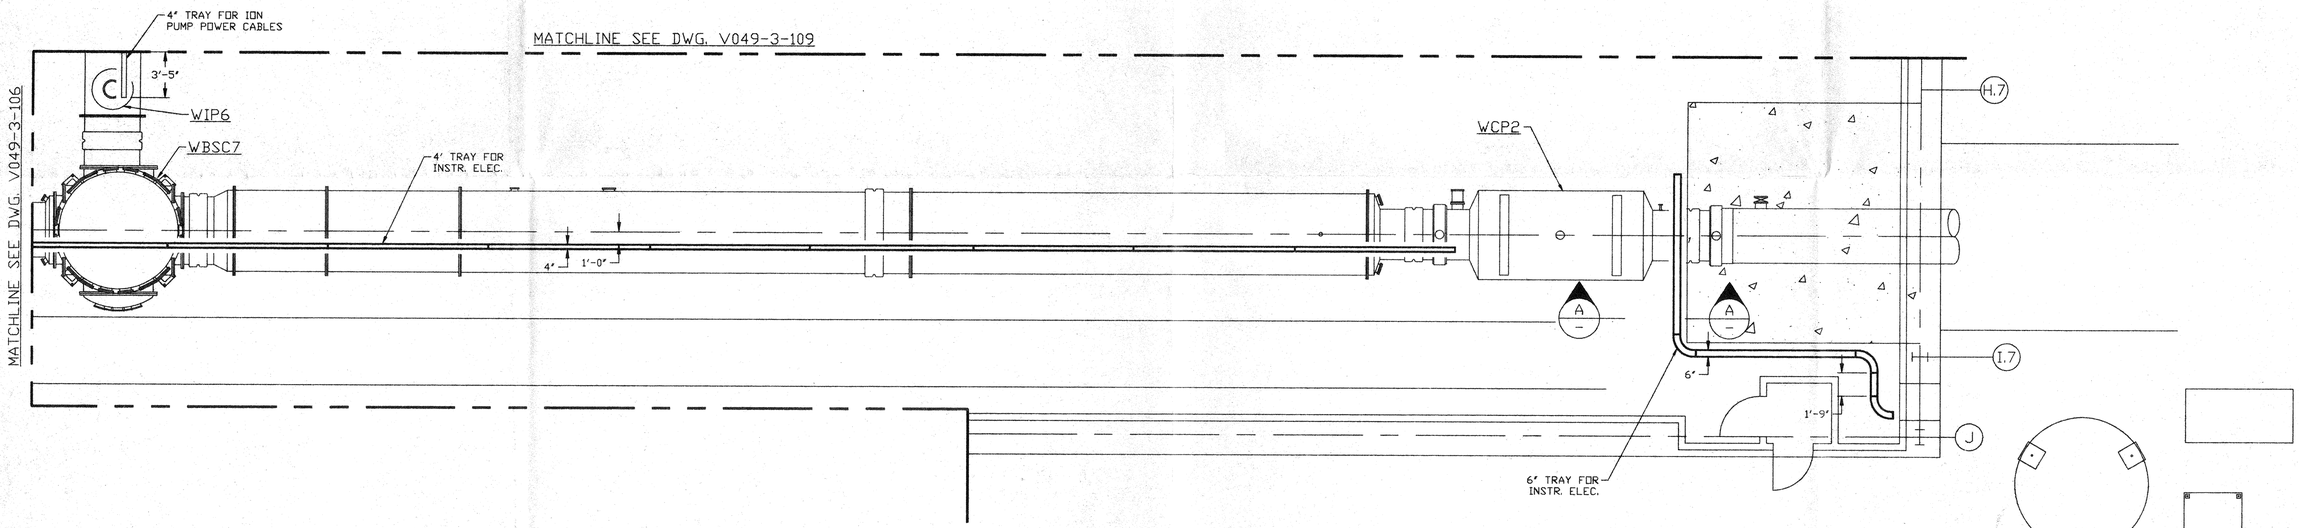

NOT FOR CONSTRUCTION

APR 30 1996

D960555-00-V

PROPRIETARY AND CONFIDENTIAL

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION BELONGING TO PROCESS SYSTEMS INTERNATIONAL, INC. OR ITS AFFILIATED COMPANIES AND SHALL BE USED ONLY FOR THE PURPOSE FOR WHICH IT WAS SUPPLIED. IT SHALL NOT BE COPIED, REPRODUCED OR OTHERWISE USED, NOR SHALL SUCH INFORMATION BE FURNISHED IN WHOLE OR IN PART TO OTHERS EXCEPT IN ACCORDANCE WITH THE TERMS OF ANY AGREEMENT UNDER WHICH IT WAS SUPPLIED OR WITH THE PRIOR WRITTEN CONSENT OF PROCESS SYSTEMS INTERNATIONAL, INC. AND SHALL BE RETURNED UPON REQUEST.

REFERENCE DRAWINGS

DWG. NO.	DESCRIPTION	DWG. NO.	DESCRIPTION
V049-3-107	CABLE TRAY PLAN DIAGONAL SECTION		
V049-3-106	CABLE TRAY PLAN VERTEX SECTION		
V049-3-002	WASHINGTON OVERALL SITE PLAN		
V049-3-001	GENERAL NOTES & LEGEND		

UNLESS OTHERWISE SPECIFIED
DIMENSIONS ARE IN INCHES
TOLERANCES:
FRACTIONAL ±
ANGULARMACH ±0'-30" BEND ±2°
TWO PLACE DECIMAL ± .01
THREE PLACE DECIMAL ± .005
FINISHED SURFACE RMS
BREAK CORNERS IN OUT
REMOVE ALL BURRS

DO NOT SCALE THIS DRAWING
USED ON:
NEXT ASS'Y:

ISSUE DESCRIPTION

REV	DESCRIPTION	CHKD	DRWN	DATE	DEQ#
0	ISSUE FOR FDR	DWH	FMB	04.26.96	0129

PROCESS SYSTEMS INTERNATIONAL INC.
20 WALKUP DR. WESTBOROUGH, MASSACHUSETTS 01581 USA

CABLE TRAY PLAN
LIGO VACUUM EQUIPMENT
WASHINGTON SITE
RIGHT BEAM MANIFOLD

CAD FILE	SIZE	DWG. NO.	REV.
V049308	D	V049-3-108	0
SCALE 3/16" = 1' - 0"		SHEET 1 OF 1	