
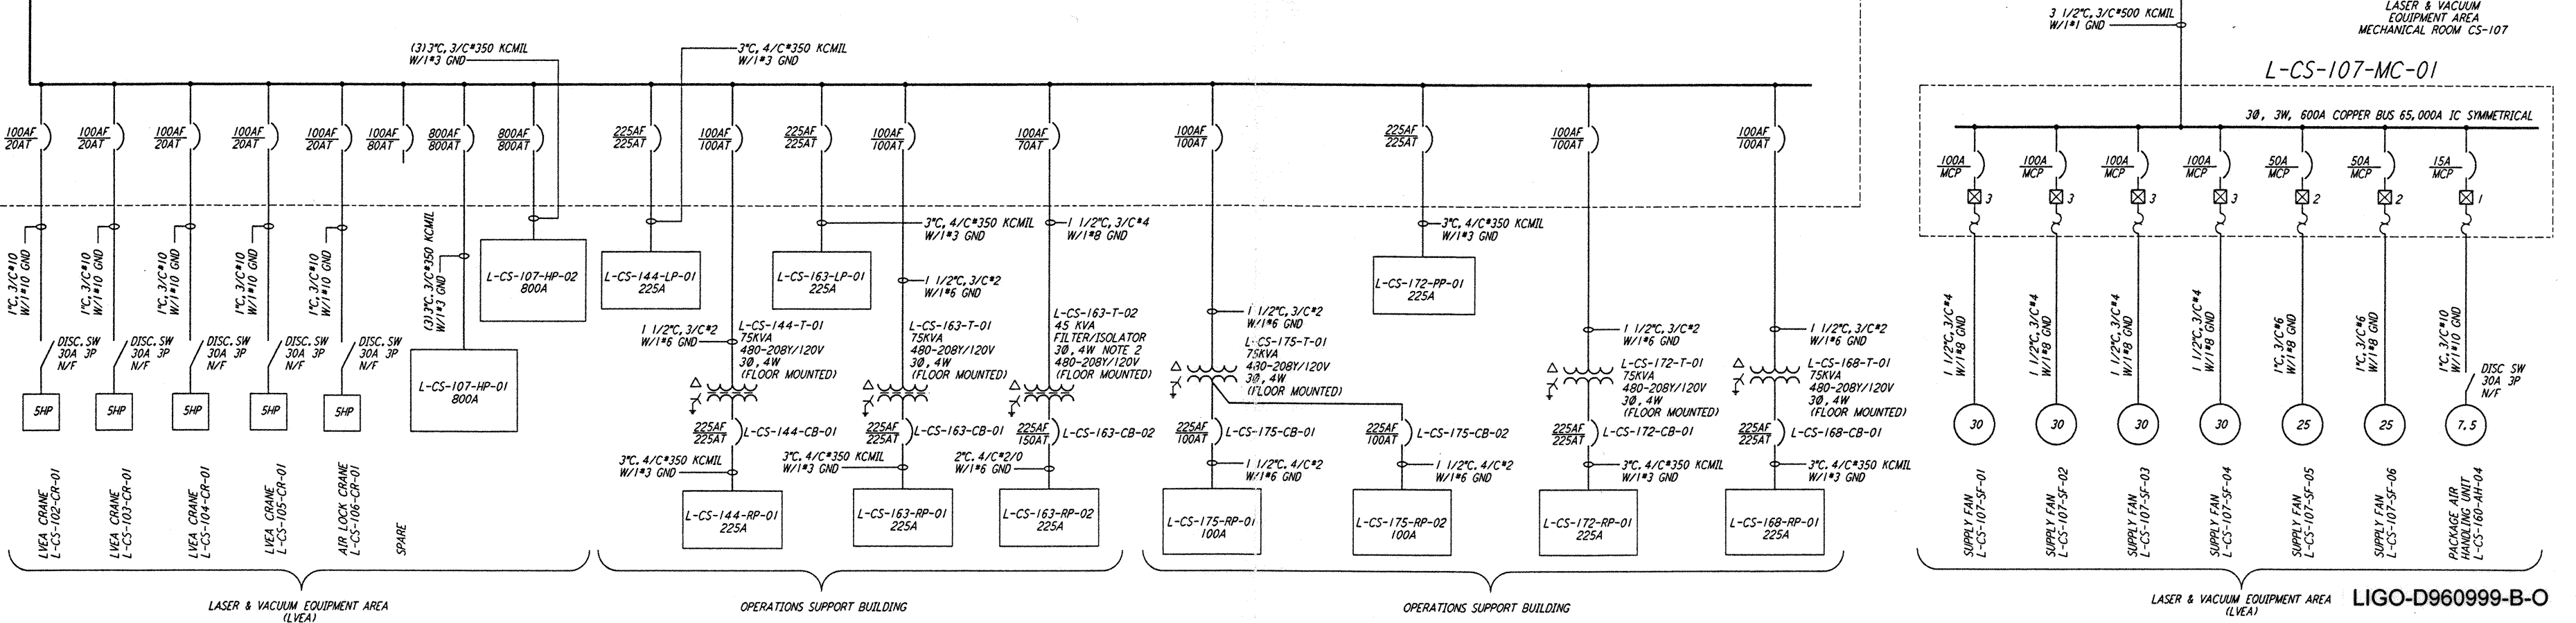
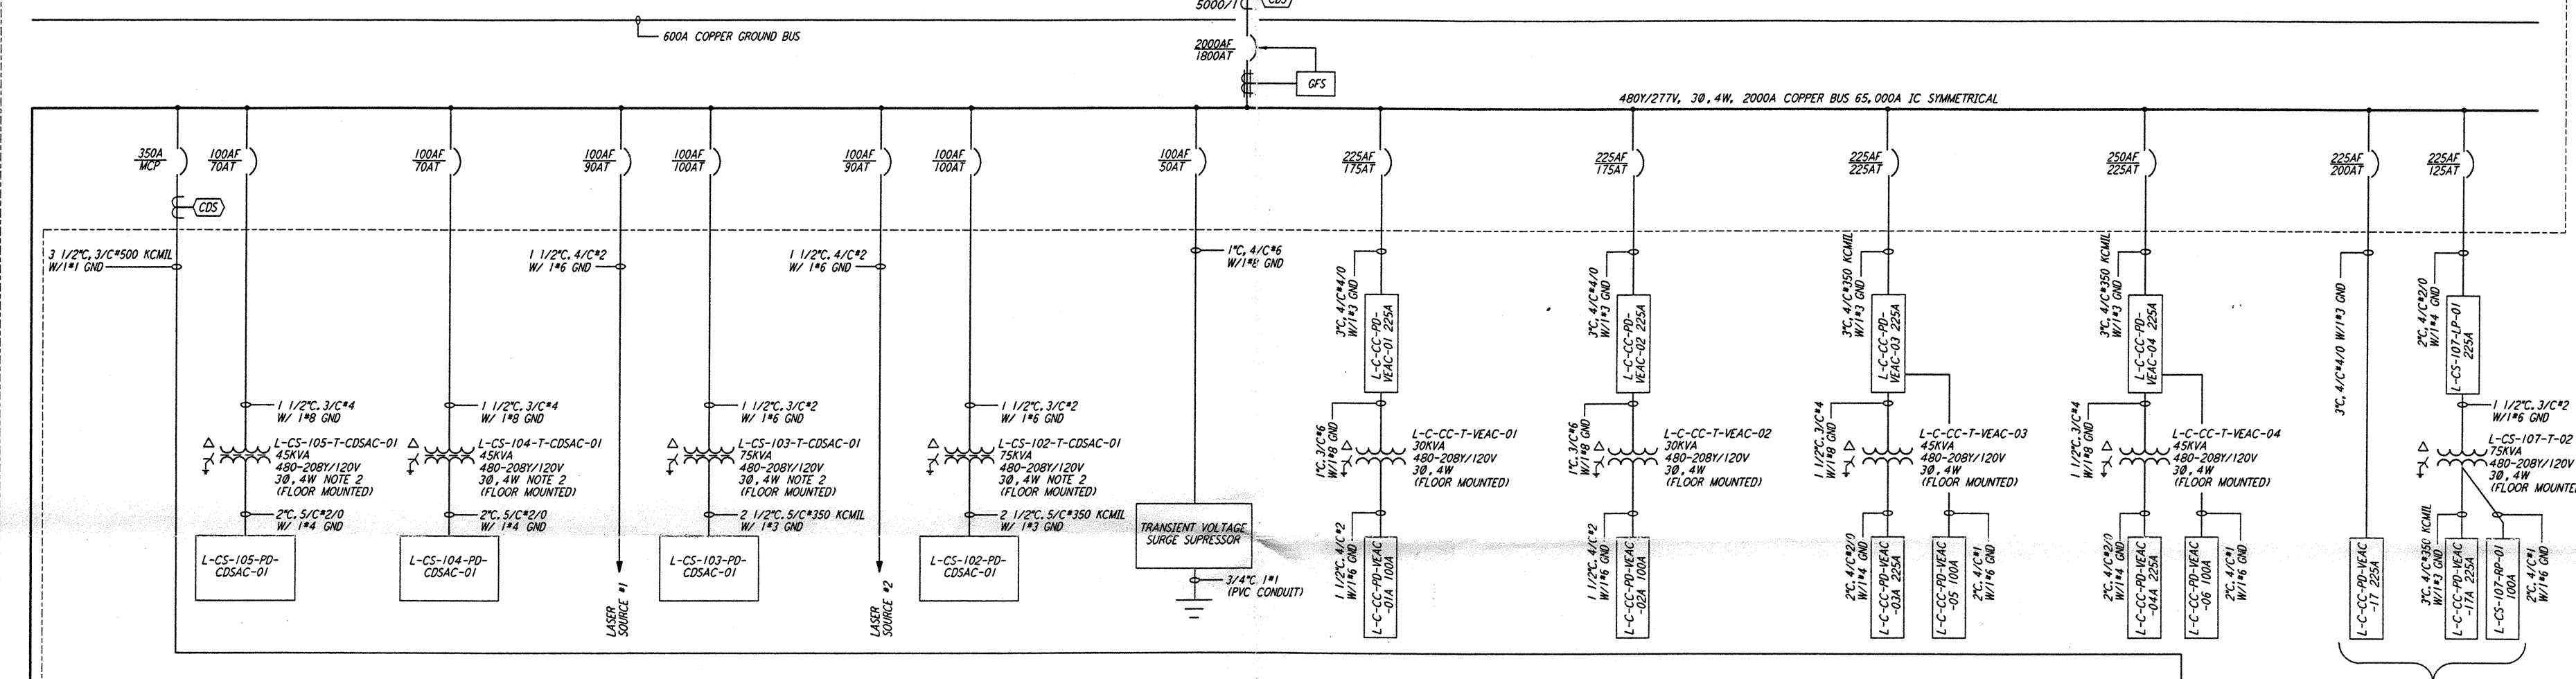


- NOTES:**
- FOR LEGEND AND GENERAL NOTES SEE DWG LA-E-005.
 - TRANSFORMERS FEEDING THE CDSAC PANELS ARE TO BE K-13 RATED AND SHALL INCORPORATE AN INTERWINDING SHIELD, GROUNDED TO THE CASE GROUND. TRANSFORMERS ARE TO BE SUITABLE FOR OUTDOOR SERVICE.
 - CDSAC PANELS SHALL HAVE 200K RATED NEUTRAL BUSES.
 - GROUND CONDUCTOR FROM TRANSFORMER NEUTRAL/CASE BOND JUNCTION TO GROUND GRID SHALL BE NO LONGER THAN 4 FT.
 - ALL CIRCUIT BREAKERS SHALL BE PROVIDED WITH LOCKING/LOCKABLE ACCESSORIES TO ENSURE THAT CIRCUITS ARE ENERGIZED BY AUTHORIZED PERSONNEL ONLY.
 - DISTRIBUTION AND LIGHTING PANELS SHALL BE FURNISHED WITH LOCKABLE DOORS. CIRCUIT BREAKERS SHALL BE PROVIDED WITH LOCKING/LOCKABLE ACCESSORIES TO ENSURE THAT CIRCUITS ARE ENERGIZED BY AUTHORIZED PERSONNEL ONLY.

**SWITCHBOARD L-CS-107-SB-01
SQUARE D CLASS 2741**

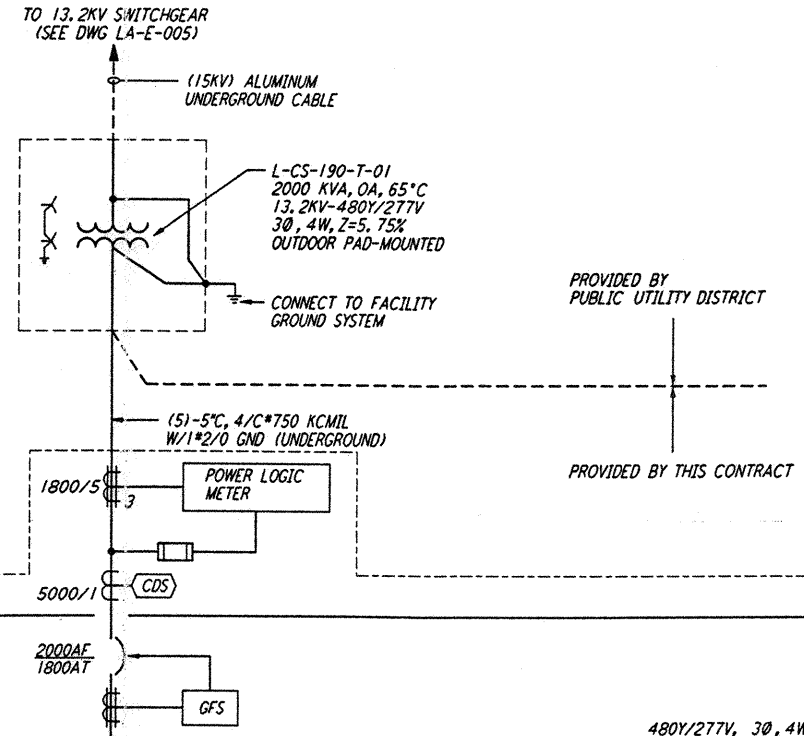

not be reproduced, copied, loaned, exhibited, or used in any other way, except by written consent from PARSONS to the borrower.

This document and the design it covers are the property of PARSONS. They are loaned only with the borrower's expressed written agreement that they will

DATE: JUN 10 10:25:11 1996 BY: S1-EDDC J:\VLS\US\SUB\DESIGN\1\BDC\EE\BDD\PPF

NO.	DATE	BY	CHKD	ENGR	PROJ	DESCRIPTION
B	6-14-96	JCL	JCL	TDM		FINAL DESIGN REVIEW
A	10-31-95	TDM				PRELIMINARY DESIGN REVIEW

NO.	DATE	BY	CHKD	ENGR	PROJ	DESCRIPTION

NO.	DATE	BY	CHKD	ENGR	PROJ	DESCRIPTION

PARSONS
100 WEST WALNUT STREET
PASADENA, CALIFORNIA

LIGO
CALIFORNIA INSTITUTE OF TECHNOLOGY
MASSACHUSETTS INSTITUTE OF TECHNOLOGY

**LASER INTERFEROMETER
GRAVITATIONAL-WAVE OBSERVATORY
SITE NO. 2 - LIVINGSTON, LOUISIANA**

TITLE	PROJECT NUMBER	PROJECT NUMBER
ELECTRICAL CORNER STATION SINGLE LINE DIAGRAM	NONE	PP150969 8094

LA-E-006