
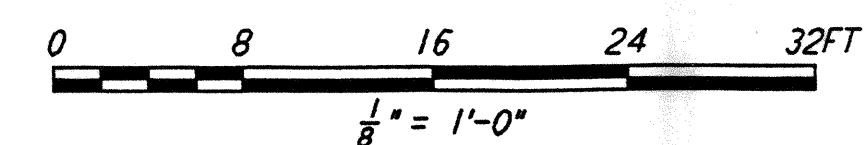


- NOTES:**
- FOR PLAN SYMBOLS SEE DWG LA-E-002.
  - WIRING FOR FIRE DETECTION SHALL BE CLASS "A", FOR FIRE ALARM DEVICES SHALL BE CLASS "B". WIRING INSTALLED IN CONCEALED CONDUIT FOR FIRE DETECTION AND SECURITY SYSTEMS SHALL BE DONE BY OTHERS.
  - DUCT MOUNTED SMOKE DETECTORS SHALL BE PROVIDED WITH AN AUXILIARY RELAY CONTACT (N.C.) FOR EQUIPMENT SHUT-DOWN.
  - COORDINATE AHU LOCATIONS WITH DUCT MOUNTED SMOKE DETECTORS.
  - TELEPHONE AND DATA RECEPTACLES SHOWN IN MIDDLE OF ROOMS SHALL BE PROVIDED WITH IMBEDDED 3/4" CONDUIT TO NEAREST PERMANENT WALL, WITH RISER TO ABOVE CEILING CAVITY.
  - DATA AND PHONE LINES SHALL BE HOMERUN FROM WALL AND FLOOR RECEPTACLES TO BACKBOARD IN ROOM 163.
  - WIRE RUNS IN CEILING CAVITY SHALL BE ORDERLY.

SYMBOL REPRESENTS DUAL TELEPHONE AND DATA (CAT 5) RECEPTACLE (TYP)

REMOTE FIRE ANNUNCIATION PANEL

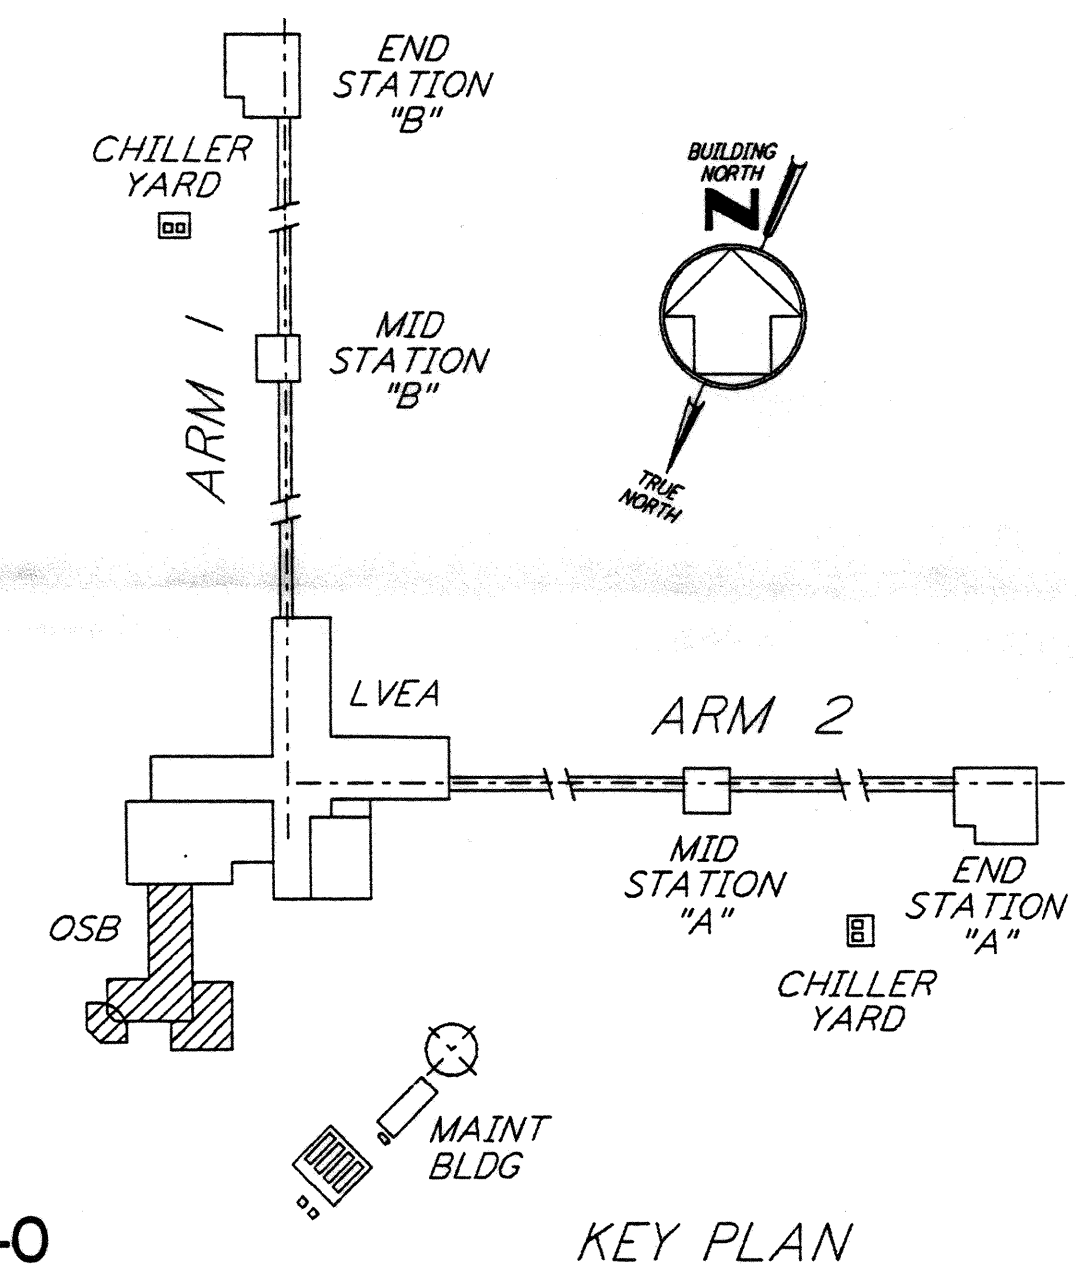

LIGO-D961012-01-0


KEY PLAN

not be reproduced, copied, loaned, exhibited, or used in any other way, except by written consent from PARSONS to the borrower.

This document and the design it covers are the property of PARSONS. They are loaned only with the borrower's expressed written agreement that they will

NO.	DATE	BY	CHKD	ENGR	PROJ	DESCRIPTION
1	2-28-97	J.G.	roc			GENERAL REVISIONS

ISSUED FOR CONSTRUCTION  
 DRAWN M. M. 11-15-96  
 CHECKED J. C. L. 7-24-96  
 ENGINEER K. C. R. 10-25-96  
 PROJ T. D. M. 11-15-96

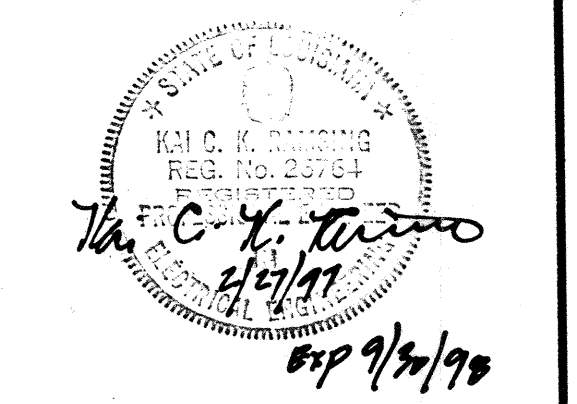

**PARSONS**  
 100 WEST WALNUT STREET  
 PASADENA, CALIFORNIA

**LIGO**  
 CALIFORNIA INSTITUTE OF TECHNOLOGY  
 MASSACHUSETTS INSTITUTE OF TECHNOLOGY

LASER INTERFEROMETER  
 GRAVITATIONAL-WAVE OBSERVATORY  
 SITE NO. 2 - LIVINGSTON, LOUISIANA

**ELECTRICAL  
 CORNER STATION  
 OSB OFFICE AREA FIRE DET  
 & COMM PLAN**

SCALE: NONE  
 CONTRACT NUMBER: PP150969  
 PROJECT NUMBER: 8094  
 SHEET NUMBER: **LA-E-110**