


PSI CDS

CDS PSI

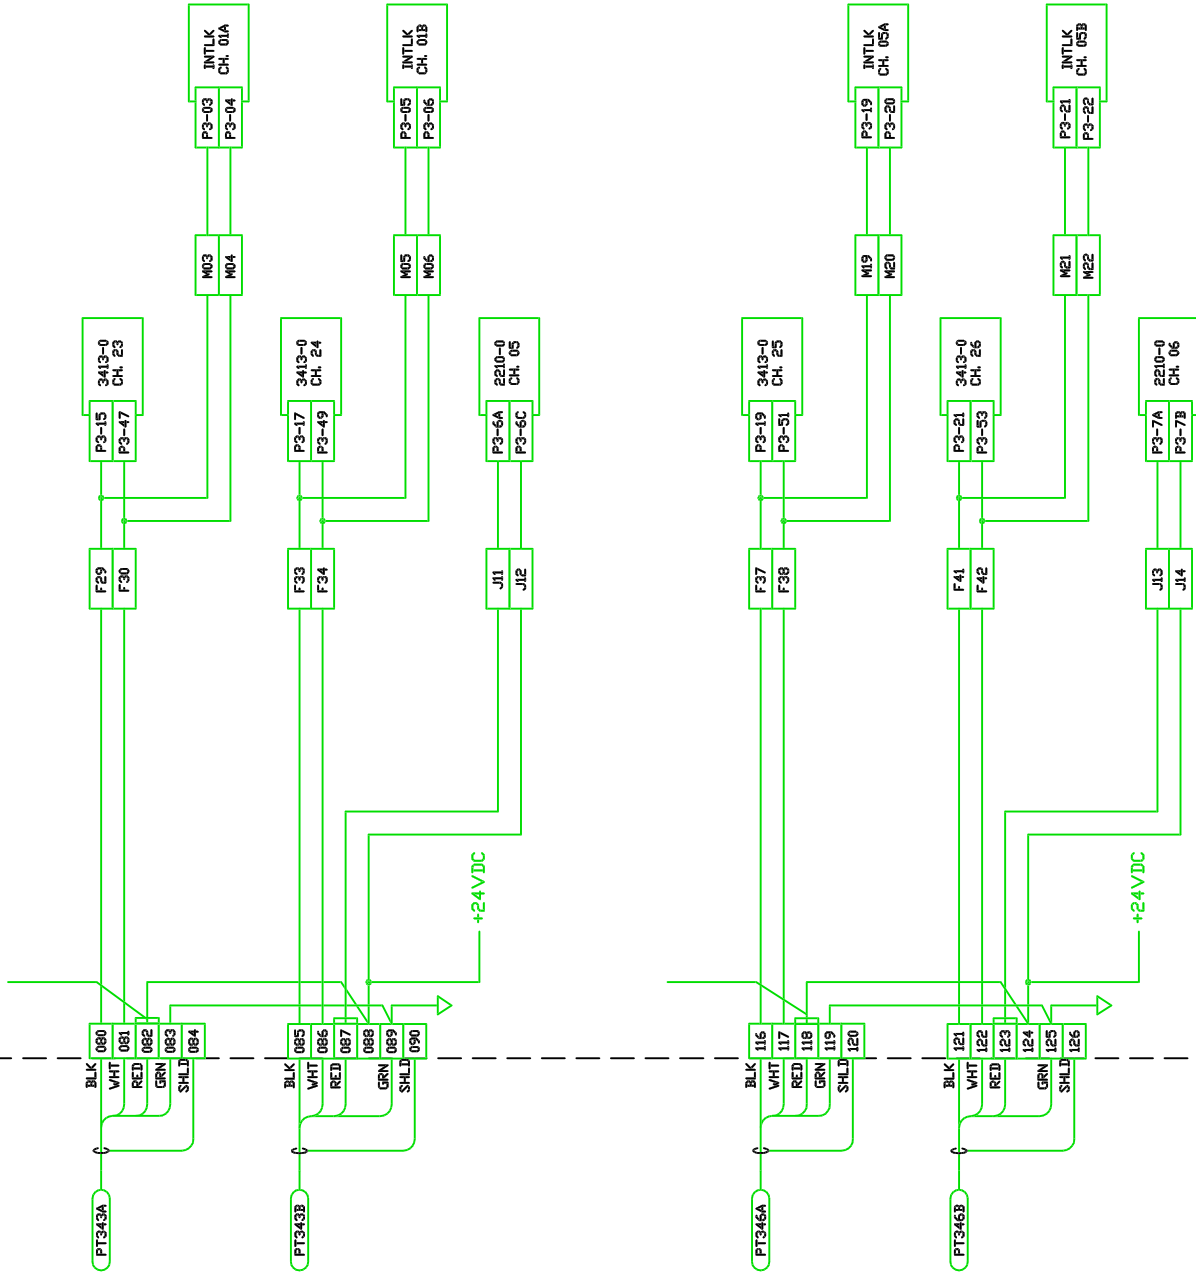

| | | | | | |
|--|--|---|--|--|--|
| UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES: FRACTIONS ± .005 DECIMALS ± .001 HOLE PLACES, RECDIALS ± .002 FINISHED SURFACES ± .001 BREAK CORNERS IN REMOVE ALL BUBBLES | | CURRENT REVISION APPROVAL DRAWN: TONY T. CDS CHECKED: R. Bork DATE: 9-9-96 | | LUGO CALIFORNIA INSTITUTE OF TECHNOLOGY MASSACHUSETTS INSTITUTE OF TECHNOLOGY VCMS ELECTRICAL DIAGRAM WA RIGHT MID STATION BEAM TUBE GUAGE PAIRS | |
| DO NOT SCALE THIS DRAWING USED IN: _____ NEXT ASSY: _____ | | SHEETS EFFECTED: _____ DATE: 1/3/97 | | SCALE: _____ CAB FILE: 134251C0 | |
| DESCRIPTION: _____ REV: _____ | | ISSUE DESCRIPTION: _____ 3 | | REV: 00 VER: 01 | |
| DWG. NO. _____ REFERENCE DRAWINGS: _____ | | DWG. NO. _____ DESCRIPTION: _____ | | DWG. NO. _____ DESCRIPTION: _____ | |
| DWG. NO. _____ DESCRIPTION: _____ | | DWG. NO. _____ DESCRIPTION: _____ | | DWG. NO. _____ DESCRIPTION: _____ | |

6

5

4

3

2

1