


DISTRIBUTION PANEL - 480 VAC

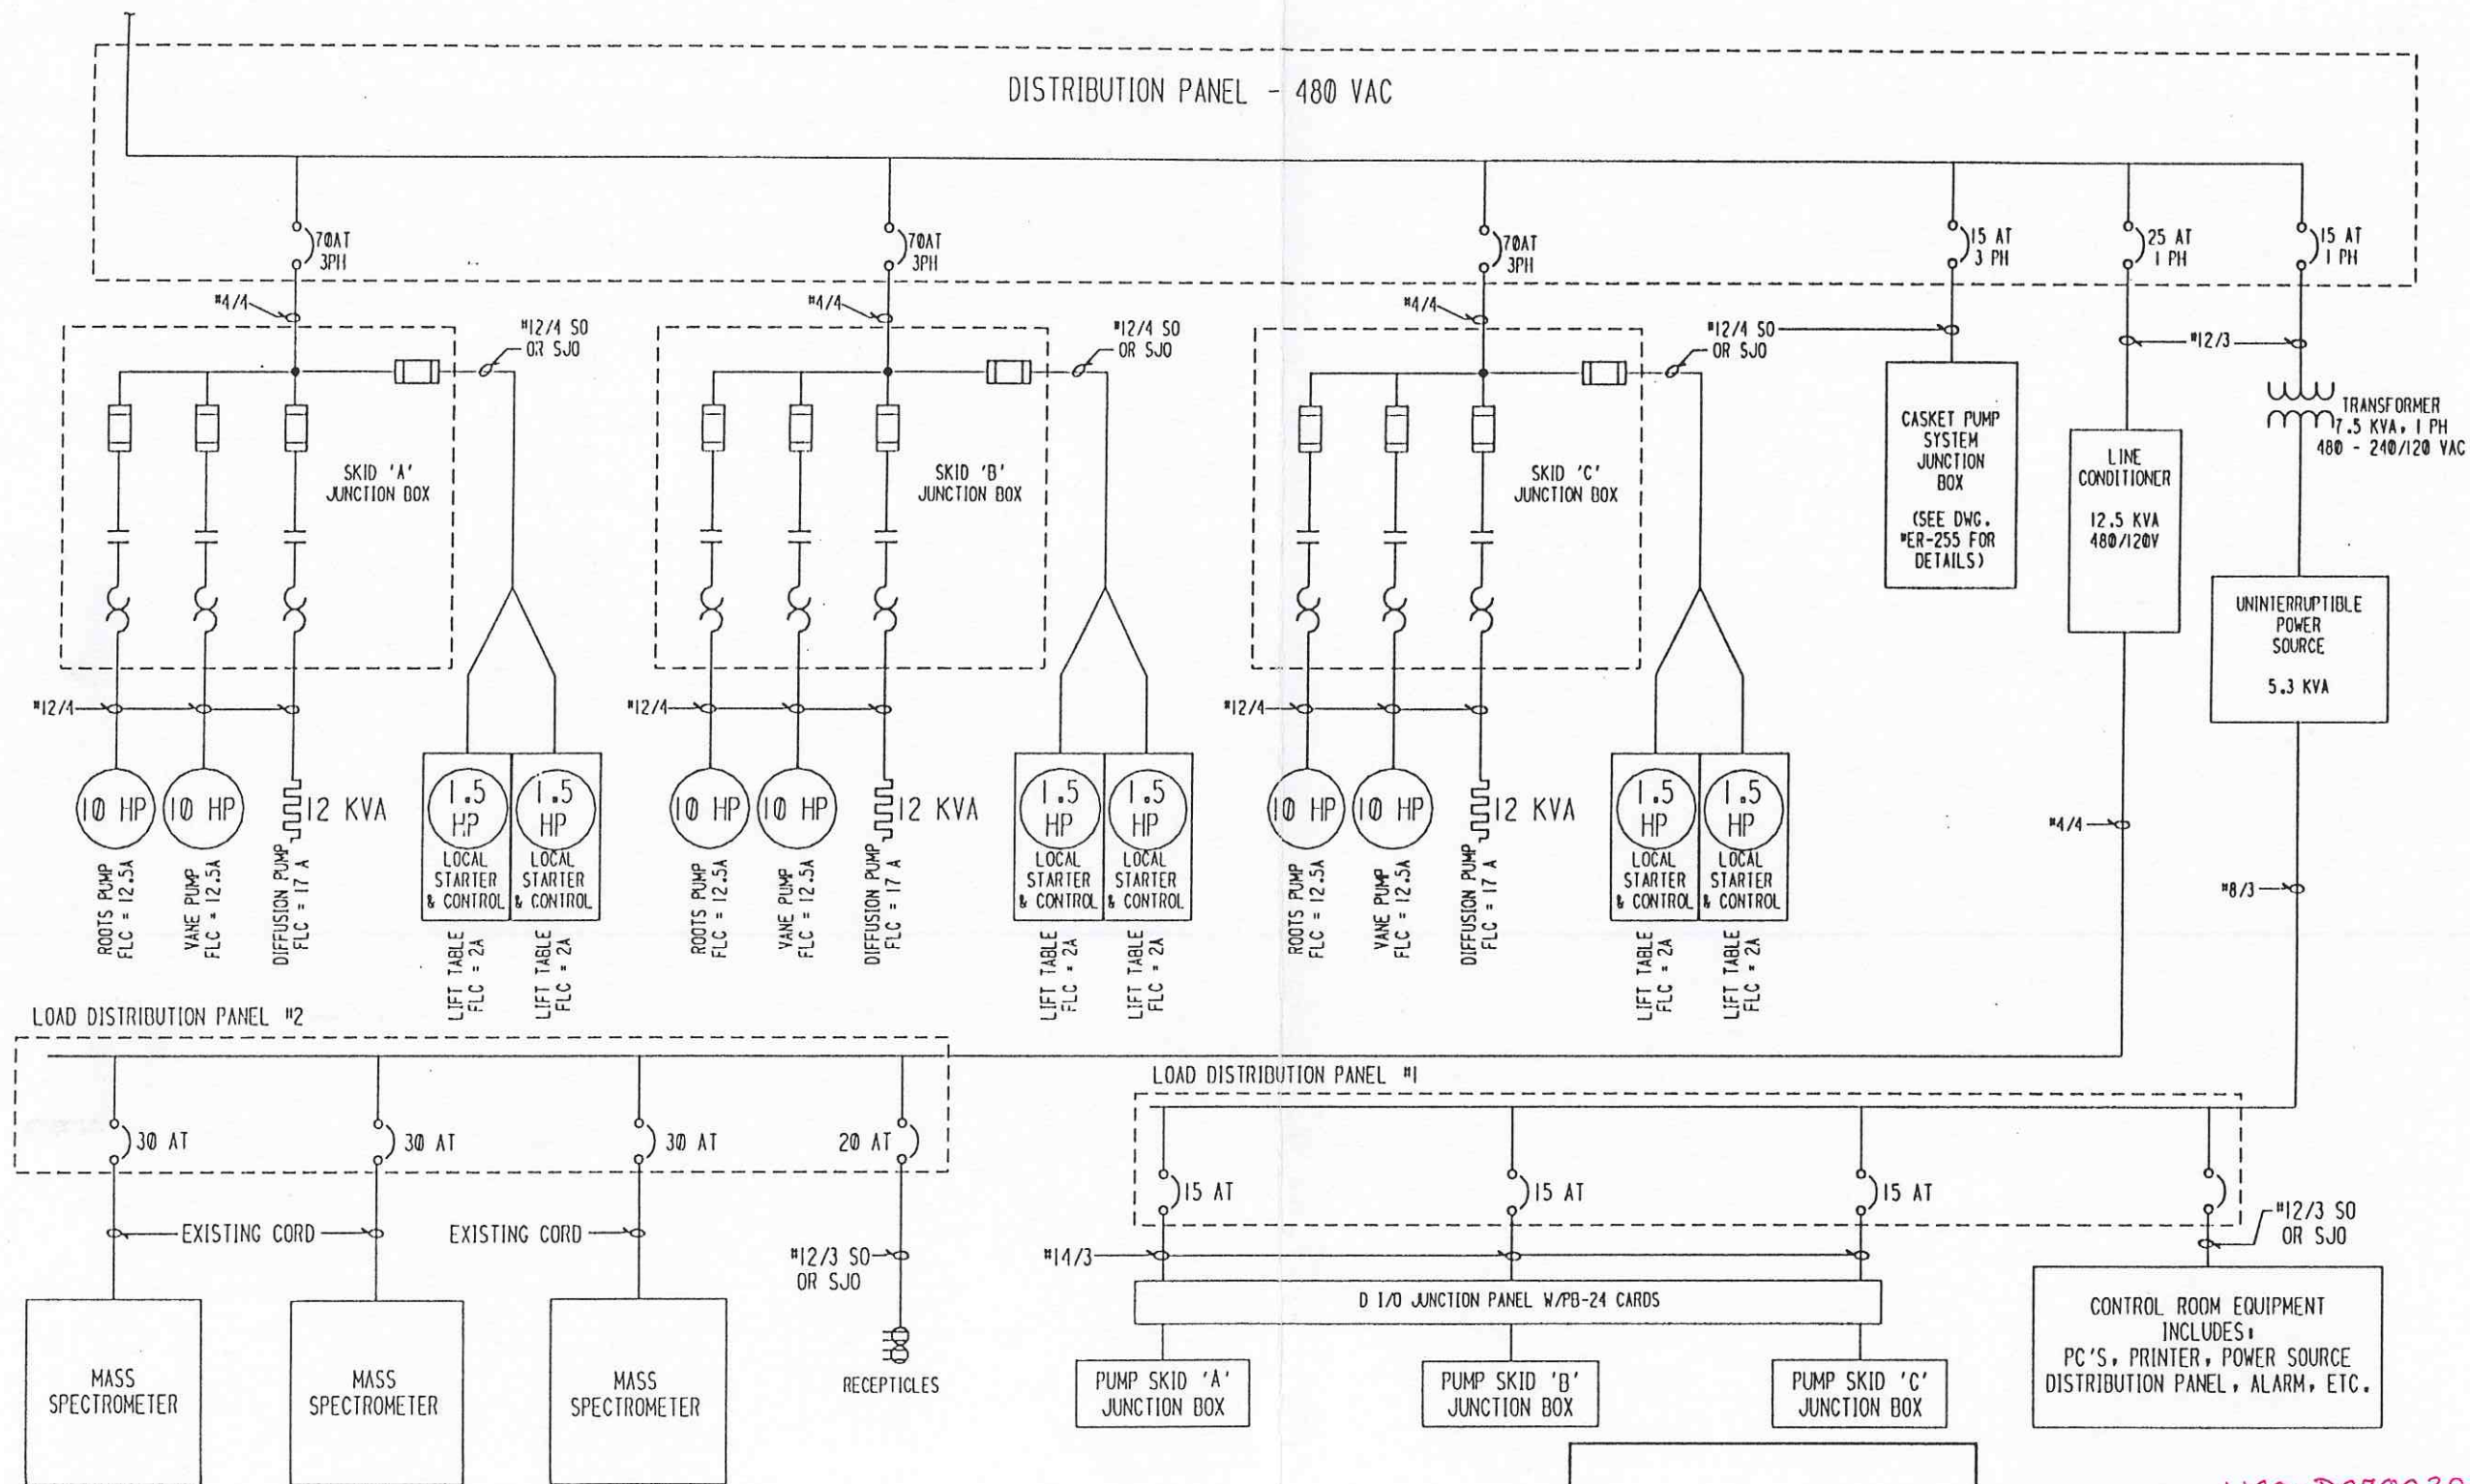

CONTROL ROOM EQUIPMENT INCLUDES:
PC'S, PRINTER, POWER SOURCE
DISTRIBUTION PANEL, ALARM, ETC.

LIGO-D970039-02-B

<p>MADE ELECTRONIC VERSION BY: <i>DWC</i> DATE: <i>5/23/96</i></p> <p>RAISED KVA RATINGS BY: <i>DWC</i> DATE: <i>5/23/96</i></p> <p>ADDED WIRE TYPE/SIZE BY: <i>DWC</i> DATE: <i>5/23/96</i></p>		<p>REMARKS</p> <p>CBI SUPPLIER'S / PURCHASER'S NO</p> <p>SECTION TEST SYSTEM POWER SINGLE LINE DIAGRAM</p> <p>LIGO - ER</p>	
<p>CUSTOMER'S NO</p> <p>BY: <i>DWC</i> <i>CRK</i> <i>8/24</i> DATE: <i>3/25/96</i></p> <p>ENGINEERING ASSIGNED</p>		<p>CONTRACT NO</p> <p>953571</p> <p>DWC ER251 REV 2</p>	
<p>THIS DRAWING HAS BEEN PREPARED FOR AND IS THE PROPERTY OF CBI AND IS TO BE USED ONLY IN CONNECTION WITH PERFORMANCE OF WORK BY CBI. REPRODUCTION IN WHOLE OR IN PART FOR ANY OTHER PURPOSE IS EXPRESSLY FORBIDDEN.</p>			

INDICATES CHANGE FROM PREVIOUS ISSUE