
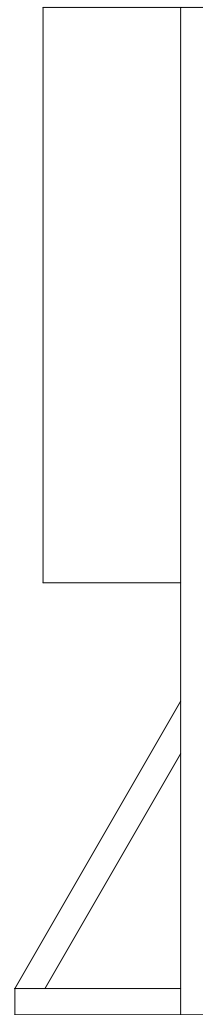


NOTES:

- 1) CONTRACTOR SHALL SUPPLY LABOR AND MATERIALS TO FIELD INSTALL FABRICATED RELAY PANEL ON STAND ALONE UNISTRUT FRAME COMPLETE.
- 2) SEE DRAWINGS D980029,30,31 FOR RELAY WIRING DIAGRAMS.
- 3) CONTRACTOR SHALL SUPPLY LABOR AND MATERIALS TO ANCHOR ASSEMBLY TO WALL OR FLOOR WITH MINIMUM OF TWO 3/8" ANCHORS AT EACH TEMPORARY LOCATION.

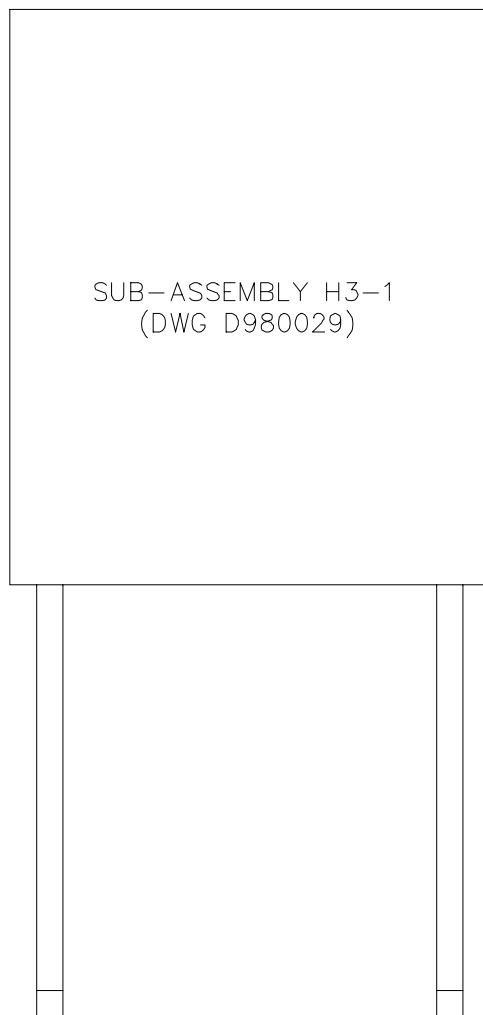

LIGO-D980028-A-W

SCALE: 1"=1'-0"

DEITTLE AND ASSOCIATES, INC.

FILE: LIGOH3 DATE: JAN 1998

HEATING BLANKET RELAY
PANEL ASSEMBLY 'H3'