


NOTES:

- 1) INSTALL THERMOCOUPLE WIRE ITEM #121 BETWEEN ITEM #112 AND ITEM #103.
- 2) SEE DRAWINGS D980030,31 FOR RELAY WIRING DIAGRAMS.
- 3) NAMEPLATE LEGEND a SHALL BE ENGRAVED WITH 1/4" HIGH LETTERING, ALL OTHER LETTERING SHALL BE 1/8" HIGH.
- 4) SEE DRAWING D980091 FOR CONTROLLER DISPLAY AND EQUIPMENT CONNECTOR TYPICAL MOUNTING LAYOUT.

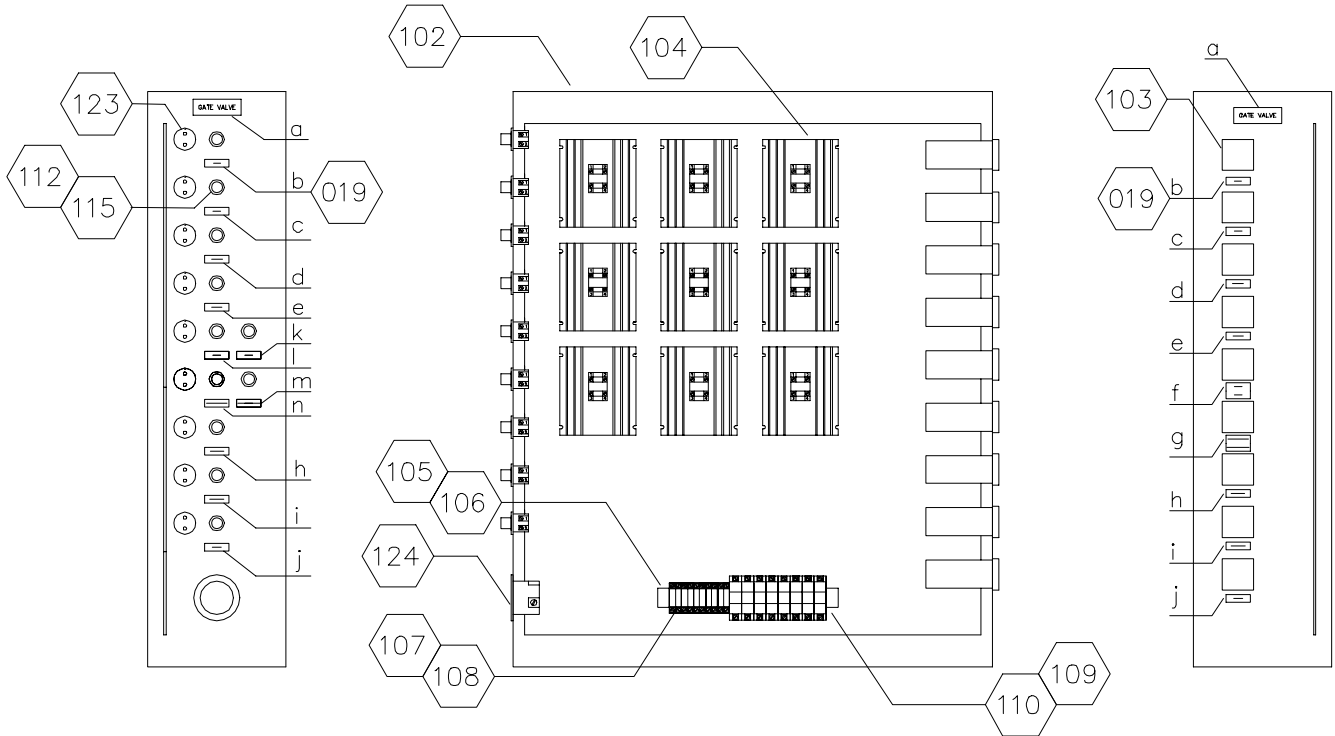

NAMEPLATE LEGEND:

- a) GATE VALVE
- b) GV-1
- c) GV-2
- d) GV-3,4
- e) GV-5,6
- f) GV-7,8
- g) GV-9,10,11,12,13,14,15,16
- h) GV-17,18
- i) GV-19,20
- j) GV-21
- k) GV-7
- l) GV-8
- m) GV-9,10,11,12
- n) GV-13,14,15,16

LIGO-D980029-A-W

SCALE: 1"=1'-0"

DEITTLE AND ASSOCIATES, INC.

FILE: LIGOH3-1 DATE: JAN 1998

SUB-ASSEMBLY 'H3-1'
HEATING BLANKET PANEL 'H3'