
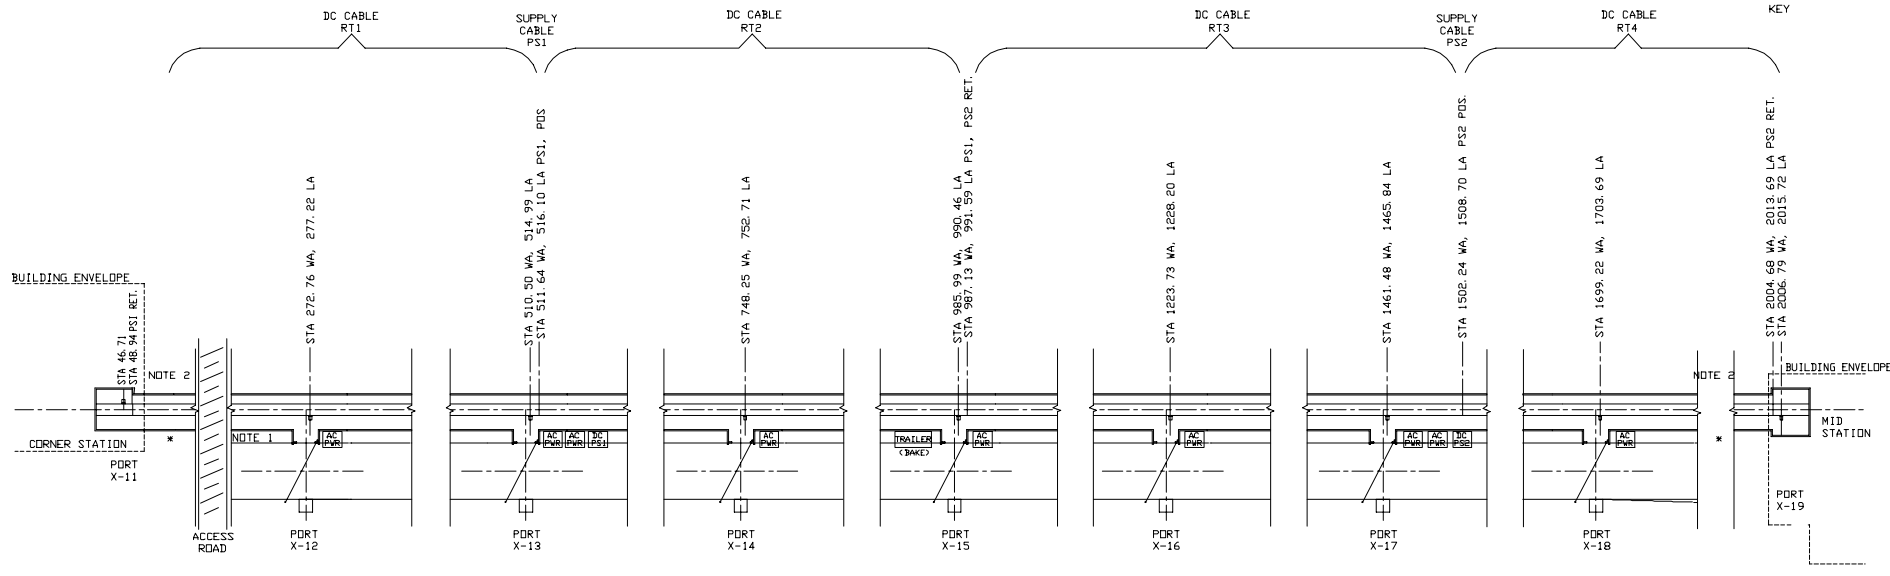


NOTES

- PULL DC CABLES THROUGH ACCESS ROAD BRIDGE.
- INSIDE SINGLE DOORS ADJACENT TO MID AND END STATIONS. POWER WILL BE SUPPLIED FROM INSIDE MID OR END STATION THROUGH ACCESS HOLES IN SHEET METAL PARTITION.

- DC - DIRECT CURRENT
- HC - BLK END HTR CABLE
- HC1 - YEL END HTR CABLE
- HJ1 - 6-WAY DISTRIBUTION BOX
- HJ2 - 2-WAY DISTRIBUTION BOX
- H1 - CONTROL BOX
- LS - PORTABLE NIGHT STAND
- LST - PORTABLE LIGHT STRING
- - PRIMARY POWER VAULT
- PS - POWER SUPPLY
- RET. - DC CABLE RETURN CONNECTION
- POS. - DC CABLE POSITIVE CONNECTION
- STA - PORT & STIFFENER RING STATION #'S
- WA, LA (<IN METERS)
- ↑ - PUMP PORT
- I - FIXED BEAM TUBE SUPPORT RING FOR DC CABLE CONNECTION

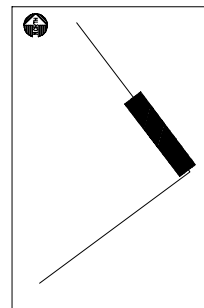

ASSEMBLY	QTY	#ASSEMBLY	QTY	ASSEMBLY	QTY	ASSEMBLY	QTY	ASSEMBLY	QTY	ASSEMBLY	QTY	ASSEMBLY	QTY	ASSEMBLY	QTY	ASSEMBLY	QTY
A2	1	C8	2	A1	1	A1	1	A3	1	A1	1	A1	1	A1	1	A1	1
C5	15	C10	2	C2	6	B8	1	C1	1	B2	1	C2	11	C2	6	C8	14
C7	1	LS	1	C4	1	C2	10	C4	1	C4	1	C4	1	C4	1	LS	1
C8	2	LST	1	C5	1	C5	1	C5	1	C5	1	C5	1	C5	1	LST	1
C10	4			C8	2	C8	2	C8	6	C8	2	C8	2	C8	2	C8	3
C11	4			C9	2	C9	2	C10	4	C10	2	C10	2	C10	2	C10	3
D	1			C10	3	C10	3	E	1	E	1	E	1	E	1	D	1
H1	6			F	1	F	1	H1	4	H1	4	H1	4	H1	4	H1	6
H2	1			H1	4	H1	4	H1	13	H1	10	H1	10	H1	10	H2	1
H3	1			HC	10	HC	10	HC	23	HC	3	HC	3	HC	3	H3	1
H4	1			HC1	3	HC1	3	HC1	6	HC1	3	HC1	3	HC1	3	H4	1
HC	64			HJ1	3	HJ1	3	HJ1	3	HJ1	3	HJ1	3	HJ1	3	HC	1
HC1	36			LS	1	LS	1	LS	1	LS	1	LS	1	LS	1	HC1	65
HJ1	6			LST	1	LST	1	LST	1	LST	1	LST	1	LST	1	HC1	36
HJ2	15															HJ1	7
I	1															HJ2	14
																I	1
																LS	1



 DEPTX ASSOCIATES, INC. Engineers and Consultants	LIGO HANFORD, WA AND LIVINGSTON, LA		PLAN VIEW - BAKEOUT EQPT. ARRANGEMENT X-1 MODULE LIGO-D 980094-C-W	
	DWN BY: GLM	DSN BY: GW	CHK BY: JAS	DATE: 4/99

SCALE: 1" = 20' 0"